

INSTRUCTIONS FOR ATTACHING PAR-TECH® ADAPTER TO LYTESPAN® TRACK

INSTRUCTION SHEET NO.

IS:8201

0292

Page 1 of 2

FOR USE WITH LYTESPAN BASIC OR ADVENT TRACK SYSTEM ONLY




READ AND UNDERSTAND THESE INSTRUCTIONS BEFORE INSTALLING FIXTURE.

This fixture is intended for installation in accordance with the National Electrical Code and local regulations. To assure full compliance with local codes and regulations; check with your local electrical inspector before installation. To prevent electrical shock, turn off electricity at fuse box before proceeding.

Retain these instructions for maintenance reference.

INSTRUCTIONS FOR ATTACHING PAR-TECH® TO SINGLE CIRCUIT TRACK SYSTEMS


1. Insert into LYTESPAN TRACK. See Fig. 1. LOCKING LEVER must be on the same side of track as BEAD.
2. Rotate FITTING 90° clockwise until LOCKING LEVER snaps and locks in place. See Fig. 2 & 3.
3. To remove: depress LOCKING LEVER, then rotate FITTING 90° counterclockwise.

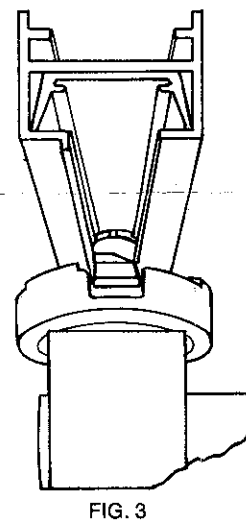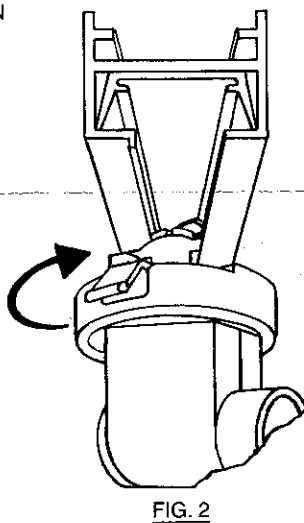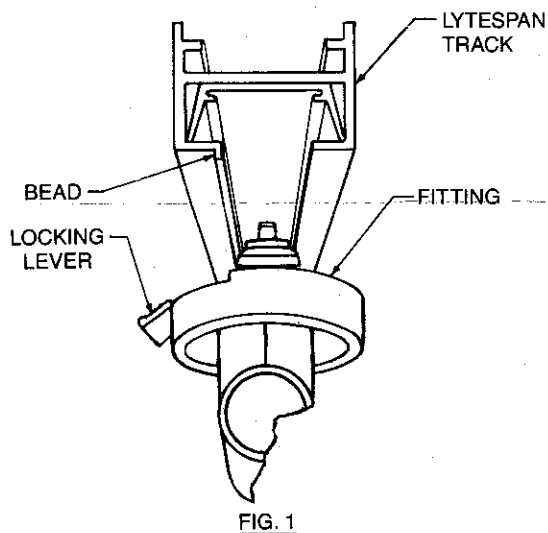

INSTRUCTIONS FOR CONVERTING FITTING TO OPERATE ON 2 CIRCUIT TRACK SYSTEMS

See Fig. 4. BRASS CONTACT can be raised or lowered. Broken line indicates position for 1 circuit or lower circuit of 2 circuit track system.

To convert attachment FITTING for upper circuit of 2 circuit track, raise BRASS CONTACT to high position by lifting CONTACT as high as stop permits and CONTACT clicks into place.

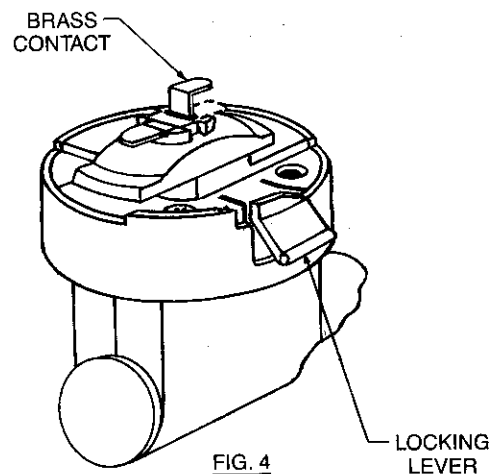


SEE BACK FOR LAMPING INFORMATION

OPERATION

Page 2 of 2

1. AIMING ADJUSTMENTS

SIMPLY ROTATE LYTESPOT TO THE DESIRED POSITION.

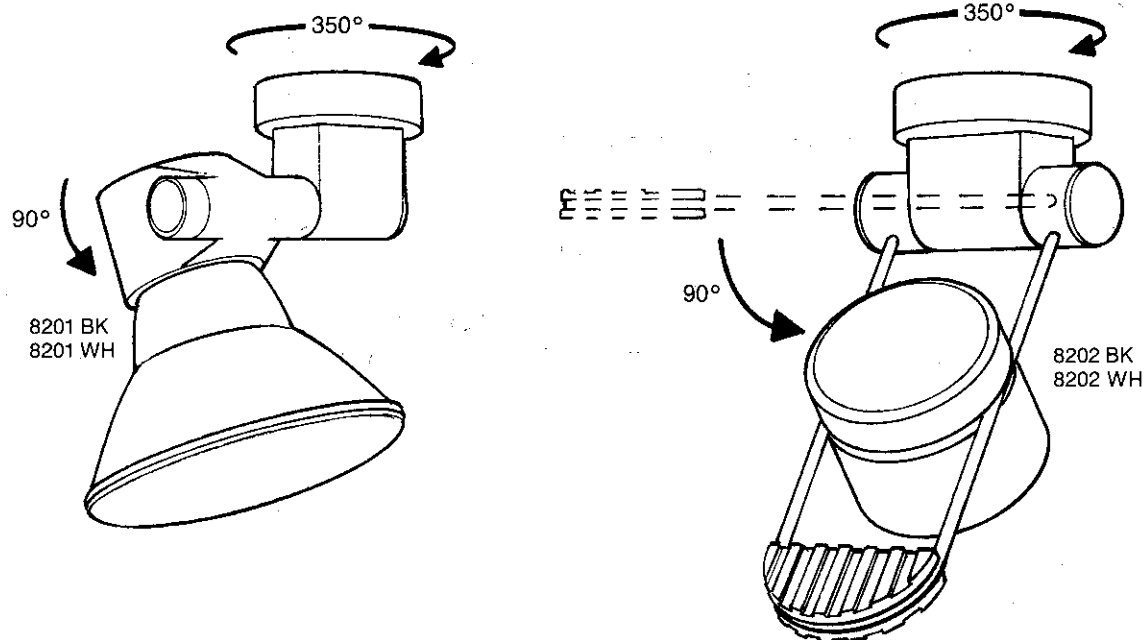

2. LAMPING

TO PREVENT ELECTRICAL SHOCK, TURN OFF POWER TO TRACK. SCREW IN THE SELECTED LAMP TYPE. SEE LIST BELOW FOR SELECTION OF APPROPRIATE INCANDESCENT LAMP TYPES AND THEIR MAXIMUM WATTAGE.

LAMPS

PAR 16 75W MAX.
PAR 20 50W MAX.
PAR 30 75W MAX.
PAR 38 150W MAX.
R20 75W MAX.
R30 100W MAX.

